

38-38
ON0015191

FERRY COUNTY SEPTIC TANK PERMIT

147
PERMIT #

Pl. 10-14-76
PERMIT ISSUANCE DATE

Oct 30 75
DATE OF NOTIFICATION OF COMPLETION

John L. Statts
APPLICANT'S NAME

779 2334
TELEPHONE

Rt m Box 160 Malo wa,
ADDRESS

John B. Statts
INSTALLER'S NAME

779 2487
TELEPHONE

Rt m Box 128 Cuslew
ADDRESS

LOCATION OF INSTALLATION: 1 mile north of Cuslew
Lake East side of Highway 21 N.

DISTANCE OF TANK & DRAIN FIELD FROM:
WATER SUPPLY 100 ft
LAKE, STREAM* 150 ft
BUILDING 20 ft


PERSONS SERVED 3
TANK CAPACITY 1000 gal
TANK CONSTRUCTION Corrent
PIPE CONSTRUCTION plastic

PERCOLATION TEST

OK CUP

SKETCH OF TANK LOCATION

Carl Whitman 6/21/76
SANITARIAN'S SIGNATURE DATE

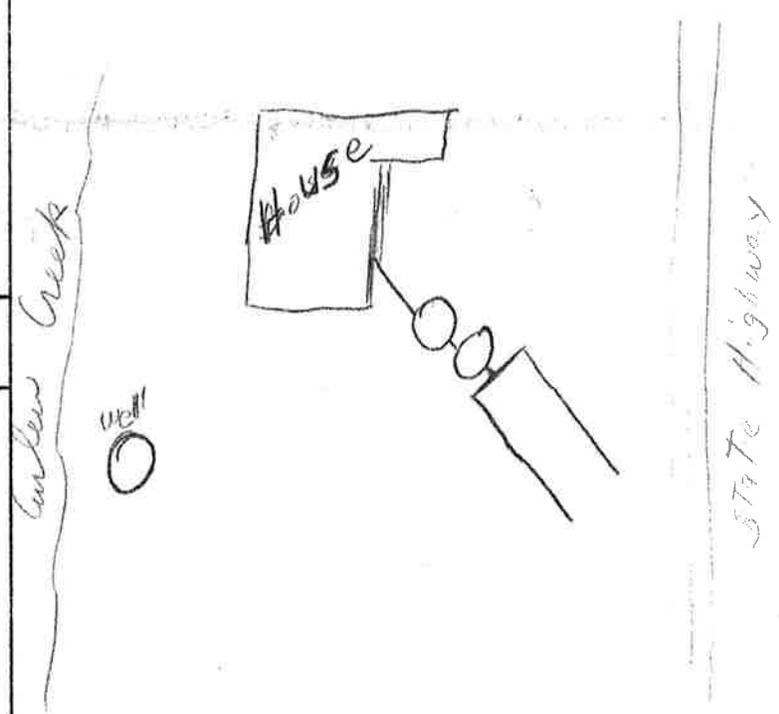

22-38-33